MEGAMAN® EMERGENCY module

LA10218 712279/MM12279

MEGAMAN® Performa FIXTURE RANGE
HIGH PERFORMANCE & QUALITY FROM MEGAMAN®

Instruction Manual | Bedienungsanleitung | Manual de instrucciones | Manuale d'istruzioni | Manuel d'instructions | Handleiding | Návod k použití

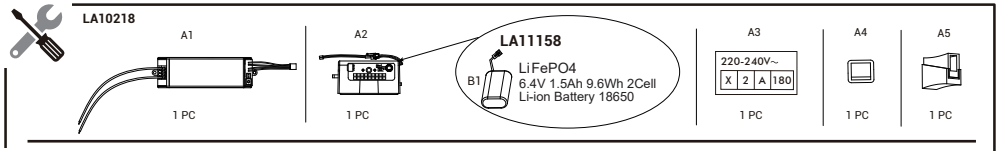

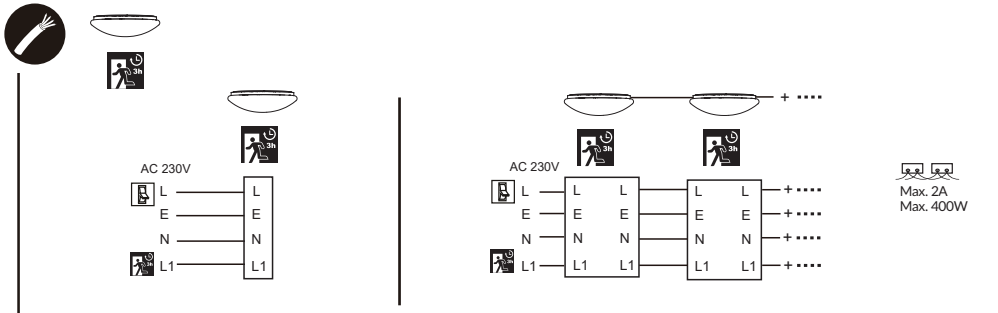

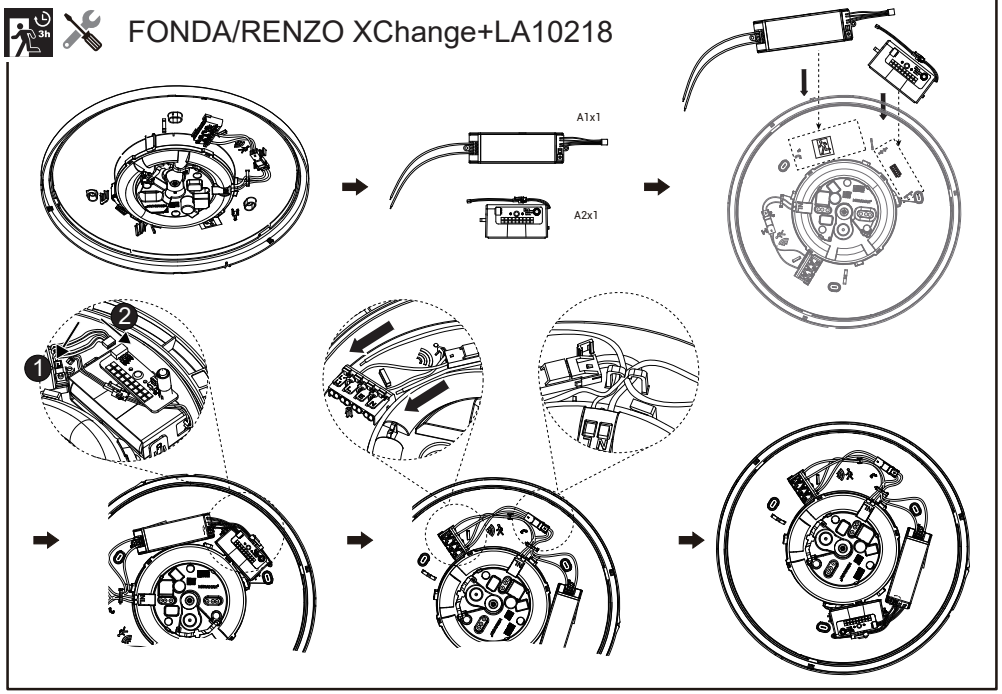

MEGAMAN® EMERGENCY module

LA10218 712279/MM12279

MEGAMAN® Performa FIXTURE RANGE
HIGH PERFORMANCE & QUALITY FROM MEGAMAN®

Instruction Manual | Bedienungsanleitung | Manual de instrucciones | Manuale d'istruzioni | Manuel d'instructions | Handleiding | Návod k použití

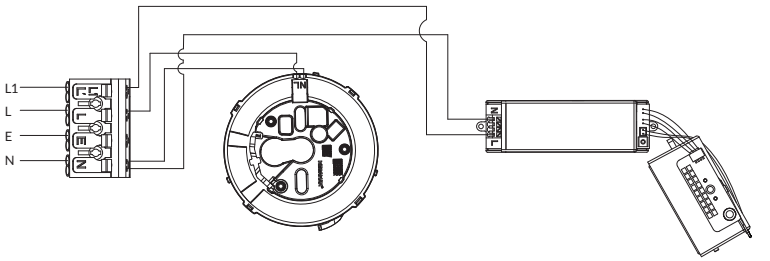

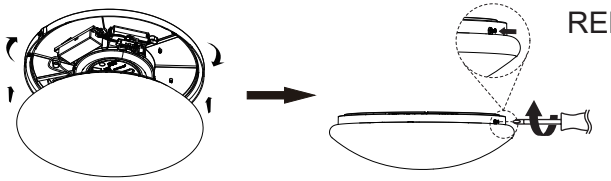

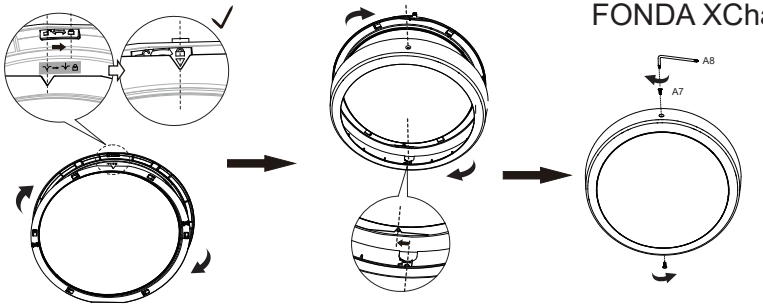

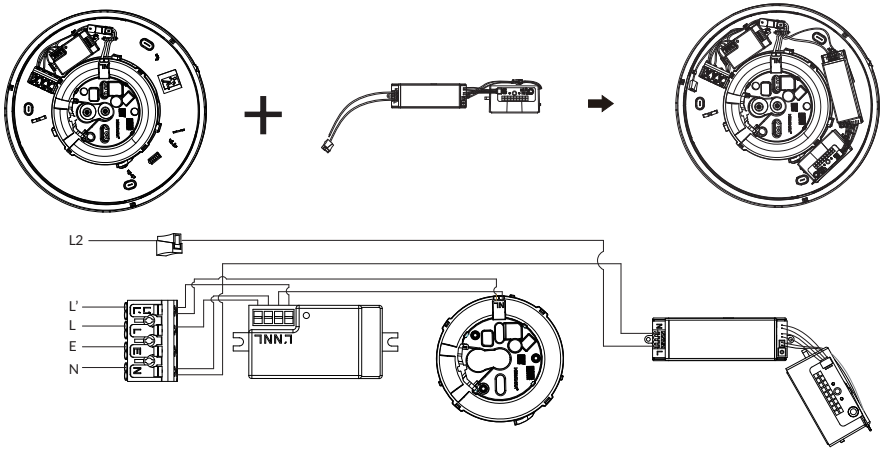

MEGAMAN®

MEGAMAN® EMERGENCY module

LA10218 712279/MM12279

MEGAMAN® Performa FIXTURE RANGE
HIGH PERFORMANCE & QUALITY FROM MEGAMAN®

Instruction Manual | Bedienungsanleitung | Manual de instrucciones | Manuale d'istruzioni | Manuel d'instructions | Handleiding | Návod k použití

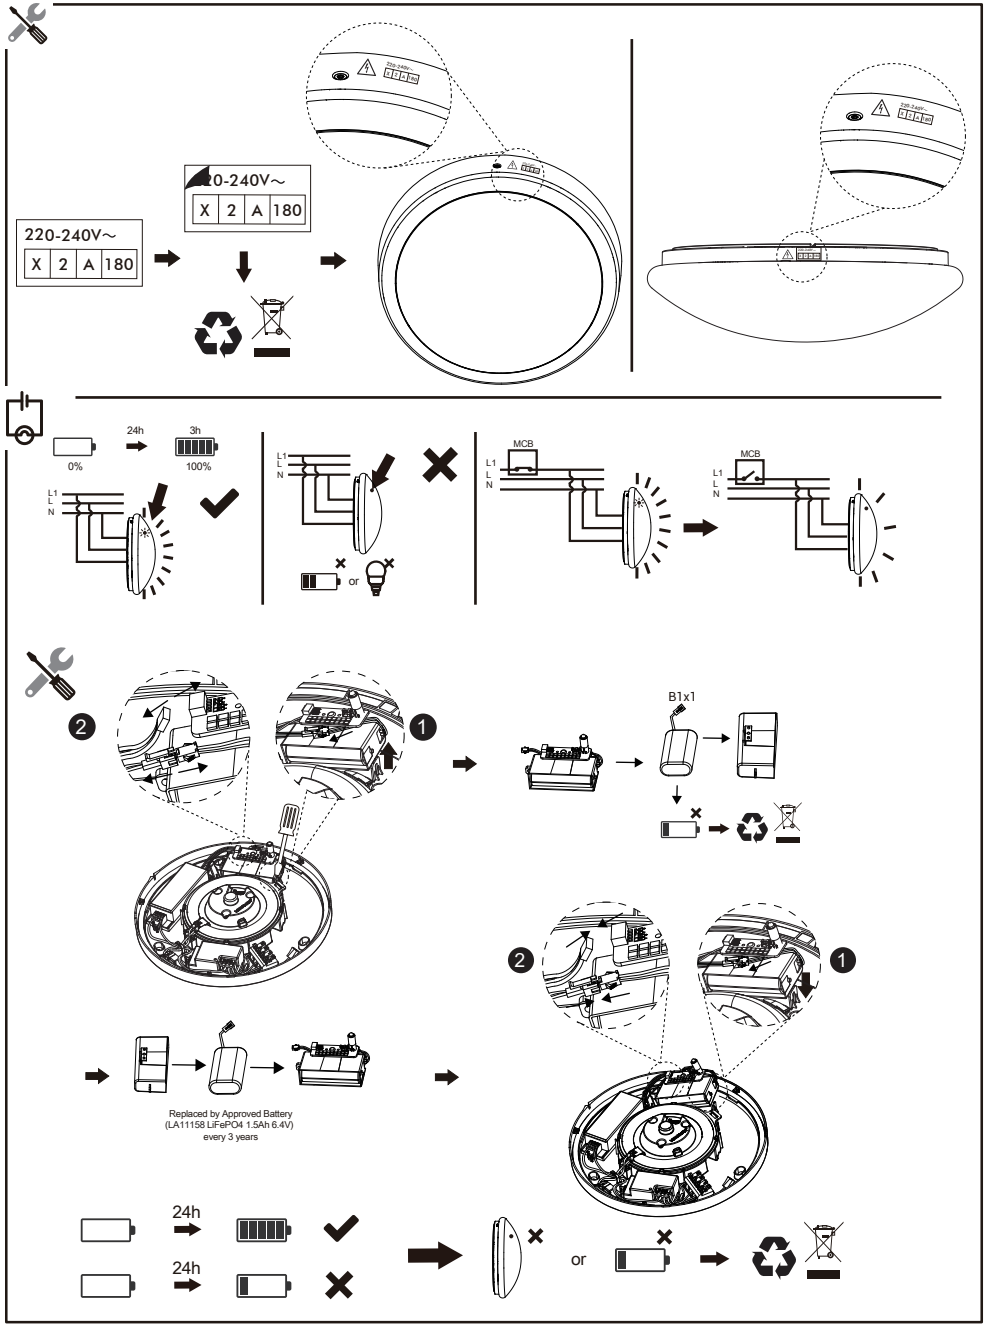

MEGAMAN® EMERGENCY module

LA10218 712279/MM12279

MEGAMAN® Performa FIXTURE RANGE
HIGH PERFORMANCE & QUALITY FROM MEGAMAN®

Instruction Manual | Bedienungsanleitung | Manual de instrucciones | Manuale d'istruzioni | Manuel d'instructions | Handleiding | Návod k použití

EMERGENCY LUMINAIRE TEST RECORD

INSTALLATION ENGINEERS _____ TEL _____

LUMINAIRE TYPE _____ IDENT/SERIAL No _____

LOCATION _____ INSTALLATION DATE _____

MONTH	TEST TYPE	FIRST YEAR		SECOND YEAR		THIRD YEAR		FOURTH YEAR		FIFTH YEAR	
		SIGN	DATE	SIGN	DATE	SIGN	DATE	SIGN	DATE	SIGN	DATE
1	FUNCTIONAL										
2	FUNCTIONAL										
3	FUNCTIONAL										
4	FUNCTIONAL										
5	FUNCTIONAL										
6	1 HOUR										
7	FUNCTIONAL										
8	FUNCTIONAL										
9	FUNCTIONAL										
10	FUNCTIONAL										
11	FUNCTIONAL										
12	1 HOUR										
13	FULL DURATION										

DAILY: check charge indicators are lit maintained/combined lamps illuminate; any faults are recorded
MONTHLY: in addition to the daily check - a functional test of at least 3 minutes duration to confilm lamp is working on battery power by simulating a mains failure.
SIX MONTHLY in addition, to the daily check - a functional test of at least one hour to confirm lamp is working on battery power by simulating a mains failure.
ANNUALLY: in addition to the daily check - a functional test of rated duration to confirm full operation to specification by simulating a mains failure.
A copy of this report must accompany any fitting returned to the manufacturer for any reason.

Caution – Risk of Electric Shock! Vorsicht - GEFAHR EINES STROMSCHLAGS! ATENCIÓN - RIESGO DE DESCARGA ELÉCTRICA! Attenzione - RISCHIO DI SCOSSA ELETTRICA! ATTENTION - RISQUE DE CHOC ÉLECTRIQUE! Voorzichtig - GEVAAR VOOR EEN ELEKTRISCHE SCHOK! POZOR! - Riziko úrazu elektrickým proudem.

The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person.
Das in dieser Leuchte enthaltene Leuchtmittel darf nur durch den Hersteller, seinen Kundendienst oder entsprechend qualifiziertes Fachpersonal ausgetauscht werden.
La fuente de iluminación de esta luminaria solo debe ser sustituida por el fabricante o su agente de servicio, o en su caso, por personal cualificado.
La sorgente luminosa contenuta in questo apparecchio deve essere sostituita esclusivamente dal produttore, dal suo rappresentante o da una persona similmente qualificata.
La source lumineuse contenue dans ce luminaire ne doit être remplacée que par le fabricant ou son agent de maintenance ou une personne de qualification équivalente.
De lichtbron in deze lamp mag alleen worden vervangen door de fabrikant, zijn serviceagent of een vergelijkbaar gekwalificeerd persoon.
Zdroj světla v tomto svítidle smí být vyměněn pouze elektrikářem, nebo servisním agentem výrobce.

	P	I	λ	Ta	Emergency lumen (lm)
LA10218 712279/MM12279	4W	Max.55mA	0.35	0°C ~ +45°C	300

Note: 1. After the main circuit is powered off, the photometric data in the emergency mode reaches 300 lm within 5 s.
2. The battery is replaceable, and the replacement of the battery is needed when they no longer meet their rated duration of operation after the corresponding recharge period.